


MODELS:

RHR1-MULTI-WP, RHR2-MULTI-WP

ELECTRICAL RATINGS:

Item	Model	Lamp Head	Input Voltage	LED Source	Lumen Output
A	RHR1-MULTI-WP	Single Head	DC3 - 12V	1W * 1	100 lm
B	RHR2-MULTI-WP	Dual Head	DC3 - 12V	1W * 2	200 lm

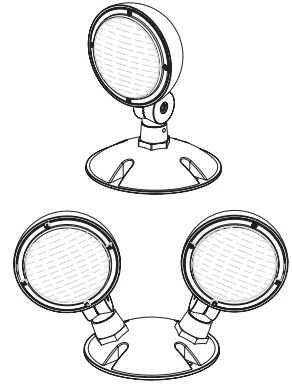

WARNINGS

IMPORTANT SAFEGUARDS

PLEASE READ AND FOLLOW ALL SAFETY INSTRUCTIONS

When using electrical, basic safety precautions should always be followed including the following.

1. Disconnect power at fuse or circuit breaker before installing or servicing.
2. Suitable for Wet location.
3. Do not mount in hazardous locations, or near gas or electric heaters.
4. Do not let power cords touch hot surface.
5. Equipment should be mounted in locations and at heights where it will not be subjected to tampering by unauthorized personnel.
6. The use of accessory equipment not recommend by the manufacturer may cause an unsafe condition.
7. Do not use this equipment for other than intended use.
8. All servicing should be performed by a qualified personnel only.

SAVE THESE INSTRUCTIONS


INSTALLATION

Installation

Connect wires to DC 3~12V supply in accordance with local and national code, yellow wire is for positive, purple wire is for negative.

Notice: This remote head is constant power, have to match specified emergency battery backup equipment recommend by the manufacturer, if use other manufacturer's emergency unit, have to test and confirm discharge time in advance.

Wiring Diagram

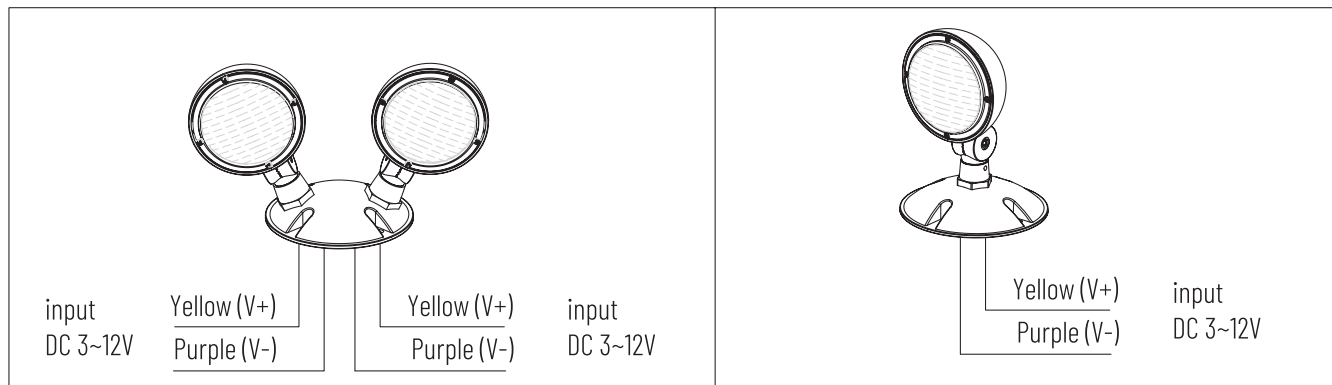


MODÈLES:

RHR1-MULTI-WP, RHR2-MULTI-WP

PARAMÈTRES DES MODÈLES:

Article	Modèle	Tête de lampe	Tension d'entrée	Source DEL	Sortie en lumens
A	RHR1-MULTI-WP	Tête simple	CC3 - 12V	1W * 1	100 lm
B	RHR2-MULTI-WP	Tête double	CC3 - 12V	1W * 2	200 lm

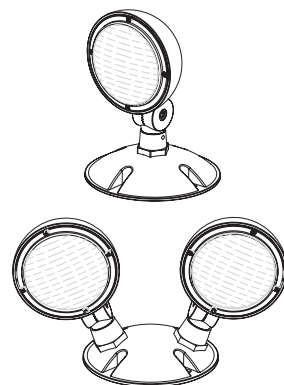

AVERTISSEMENTS

MESURES DE SÉCURITÉ IMPORTANTES

VEUILLEZ LIRE ET SUIVRE TOUTES LES INSTRUCTIONS DE SÉCURITÉ

Lors de l'utilisation d'appareils électriques, des précautions de sécurité de base doivent toujours être suivies, y compris les suivantes.

1. Déconnecter l'alimentation au fusible ou au disjoncteur avant d'installer ou de réparer.
2. Convient pour un emplacement humide.
3. Ne pas installer dans des endroits dangereux, ou près de chauffages à gaz ou électriques.
4. Ne pas laisser les cordons d'alimentation toucher une surface chaude.
5. L'équipement doit être monté dans des endroits et à des hauteurs où il ne sera pas exposé à des manipulations par du personnel non autorisé.
6. L'utilisation d'équipements accessoires non recommandés par le fabricant peut entraîner une situation dangereuse.
7. Ne pas utiliser cet équipement à d'autres fins que celles prévues.
8. Toutes les réparations doivent être effectuées uniquement par un personnel qualifié.

CONSERVEZ CES INSTRUCTIONS

INSTALLATION

Installation

Connecter les fils à une alimentation DC 3~12V conformément aux codes locaux et nationaux, le fil jaune est pour le positif, le fil violet est pour le négatif.

Avis: Cette tête distante est alimentée en continu, il faut utiliser l'équipement de batterie de secours d'urgence spécifié recommandé par le fabricant. Si un autre modèle d'unité d'urgence d'un autre fabricant est utilisé, il faut tester et confirmer le temps de décharge à l'avance.

Schéma de câblage:

